

COMPANIA DE APA TARGOVISTE DAMBOVITA S.A.**DEPARTAMENT MANAGEMENT INTEGRAT CALITATE****LABORATOR CENTRAL APA POTABILA**

Legea 458/2002(republicata) privind calitatea apei potabile-modificata si completata cu Ordonanta 22/2017

LABORATOR APA POTABILA PUCIOASA

Laborator inregistrat la Ministerul Sanatatii - Certificat nr. 592/24.10.2022, str.Debarcaderului nr.1-Pucioasa,Tel/Fax 0245762640

BULETIN DE ANALIZA FIZICO – CHIMICA NR. 1833

Solicitant: Sectia Moreni Loc de prelevare: Moreni, str. Mihai Eminescu- Magazin Bryana Corandry Punct de prelevare: robinet chiuveta magazin Cod proba: 68 Scopul analizei: verificarea calitatii apei-avarie retea Produs analizat: apa potabila Prelevat de: Virlan G.	Fisa prelevare nr: 2473 Data si ora prelevarii probei: 02.11.2022/14:45 Data si ora receptiei probei: 02.11.2022/16:15 Receptionat/inregistrat de: Hategan E. Data si ora efectuarii analizei: 02.11.2022/16:30 Data si ora finalizarii analizei: 02.11.2022/21:30 Data si ora eliberarii rezultatului: 03.11.2022/10:00
--	---

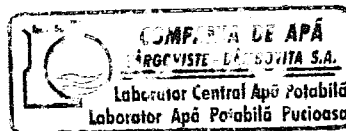
Metode de prelevare:ISO 5667-5/2017; SR EN ISO 5667-1/2022; SR EN ISO 5667-3/2018; SR EN ISO 5667-14/2017

Parametrii analizati	UM	Valoare CMA	Valoarea determinata	Metode de analiza
Concentratia ionilor de H	Unitati pH	$\geq 6,5 - \leq 9,5$	7,7(20°C)	SR EN ISO 10523:2012
Conductivitate	$\mu S / cm$ la 20°C	2500	371	SR EN 27888:1997
Turbiditate	NTU	≤ 5	0,38	SR EN ISO 7027-1:2016
Clor rezidual liber	mg/l	$\geq 0,1$ statie,rezervor $\geq 0,1 - \leq 0,5$ retea	0,32	SR EN ISO 7393-1:2002
Clor rezidual total	mg/l		0,36	SR EN ISO 7393-1:2002
% clor rezidual liber din clorul rezidual total	%	Min.80	89	
Amoniu (NH ₄ ⁺)	mg/l	0,5	SLQ	SR ISO 7150-1:2001
Culoare	-	1)	1	SR EN ISO 7887:2012-metoda C
Miros	-	2)	2	SR EN 1622:2007
Gust	-	3)	3	SR EN 1622:2007
Aluminiu	$\mu g/l$	200	94,33	SR ISO 10566:2001
Nitrati(NO ₃ ⁻)	mg/l	50	-	SR ISO 7890-3:2000
Nitriti (NO ₂ ⁻)	mg/l	0,1 statie,rezervor 0,5 retea	-	SR EN 26777:2002 SR EN 26777:2002/C91:2006
Mangan	$\mu g/l$	50	-	SR ISO 6333:1997
Fier (Fe ²⁺ ,Fe ³⁺)	$\mu g/l$	200	-	SR ISO 6332:1996/C91:2006
Suma de calciu si magneziu	Grade Germane	Minim 5	-	SR ISO 6059:2008
Indice de permanganat	mgO ₂ /l	5	-	SR EN ISO 8467:2001
Cloruri (Cl ⁻)	mg/l	250	-	SR ISO 9297:2001
Sulfati	mg/l	250	-	STAS 3069:1987

1)Acceptabila consumatorilor si nicio modificare anormala; 2)Acceptabil consumatorilor si niciun miros anormal; 3) Acceptabil consumatorilor si niciun gust anormal

*Notatia SLQ="sub limita de cuantificare a metodei"

*LQ: amoniu <0,019 mg/l

SEF LABORATOR
Ch. Dimian ClaudiaRESPONSABIL ANALIZA
Ch. Dimian Claudia

Cod F-17-6/2

Reproducerea buletinului de analiza fara acceptul scris al laboratorului este interzisa!
Rezultatele analizelor se refera numai la proba prelevata si analizata.

COMPANIA DE APA TARGOVISTE DAMBOVITA S.A.**DEPARTAMENT MANAGEMENT INTEGRAT CALITATE****LABORATOR CENTRAL APA POTABILA**

Legea 458/2002(republicata) privind calitatea apei potabile-modificata si completata cu Ordonanta 22/2017

LABORATOR APA POTABILA PUCIOASA

Laborator inregistrat la Ministerul Sanatatii - Certificat nr. 592/24.10.2022, str.Debarcaderului nr.1-Pucioasa,Tel/Fax 0245762640

BULETIN DE ANALIZA MICROBIOLOGICA NR.1790

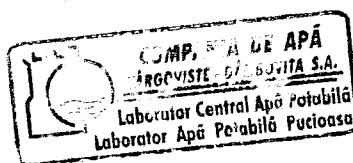
Solicitant: Sectia Moreni Loc de prelevare: Moreni, str. Mihai Eminescu- Magazin Bryana Corandry Punct de prelevare: robinet chiuveta magazin Cod proba: 68 Scopul analizei: verificarea calitatii apei-avarie retea Produs analizat: apa potabila Prelevat de: Virlan G.	Fisa prelevare nr: 2473 Data si ora prelevarii probei: 02.11.2022/14:45 Data si ora receptiei probei: 02.11.2022/16:15 Receptionat/inregistrat de: Hategan E. Data si ora efectuarii analizei: 02.11.2022/16:30 Data si ora finalizarii analizei: 05.11.2022/10:00 Data si ora eliberarii rezultatului: 07.11.2022/09:00 Correspondent cu buletin analiza fizico-chimica nr. 1833
Metode de prelevare : ISO 5667-5/2017;SR EN ISO 5667-1/2022;SR EN ISO 5667-3/2018;SR EN ISO 19458/2007;SR EN ISO 5667-14/2017	

PARAMETRII MICROBIOLOGICI DE CALITATE AI APEI POTABILE

Parametrii analizati	UM	Valoare CMA	Valoare determinata	Metode de analiza
Escherichia coli	UFC/100 ml	0	0	SR EN ISO 9308-1:2015 SR EN ISO 9308-1:2015/A1:2017
Enterococi intestinali	UFC/100 ml	0	0	SR EN ISO 7899-2/2002

PARAMETRII INDICATORI

Parametrii analizati	UM	Valoare CMA	Valoare determinata	Metode de analiza
Bacterii coliforme	UFC/100 ml	0	0	SR EN ISO 9308-1:2015 SR EN ISO 9308-1:2015/A1:2017
Nr. de colonii la 22°C	UFC/ 1ml	Nicio modificare anormala	6	SR EN ISO 6222/2004
Nr. de colonii la 37°C	UFC/ 1ml	Nicio modificare anormala	1	SR EN ISO 6222/2004
Clostridium perfringens	UFC/100 ml	0	0	SR EN ISO 14189/2017

SEF LABORATOR
Ch. Dimian ClaudiaRESPONSABIL ANALIZA
Biolog Manoiu Mirabela

Cod F-17-7/2

Reproducerea buletinului de analiza fara acceptul scris al laboratorului este interzisa!
Rezultatele analizelor se refera numai la proba prelevata si analizata.

Pag.1/1

Exemplar nr. 3

COMPANIA DE APA TARGOVISTE DAMBOVITA S.A.**DEPARTAMENT MANAGEMENT INTEGRAT CALITATE****LABORATOR CENTRAL APA POTABILA**

Legea 458/2002(republicata) privind calitatea apei potabile-modificata si completata cu Ordonanta 22/2017

LABORATOR APA POTABILA PUCIOASA

Laborator inregistrat la Ministerul Sanatatii - Certificat nr. 592/24.10.2022, str.Debarcaderului nr.1-Pucioasa,Tel/Fax 0245762640

BULETIN DE ANALIZA FIZICO – CHIMICA NR. 1834

Solicitant: Sectia Moreni Loc de prelevare: Moreni, str. Mihai Eminescu- Depozit Constructii Elix Dan Punct de prelevare: robinet cismea curte Cod proba: 69 Scopul analizei: verificarea calitatii apei-avarie retea Produs analizat: apa potabila Prelevat de: Virlan G.	Fisa prelevare nr: 2474 Data si ora prelevarii probei: 02.11.2022/15:00 Data si ora receptiei probei: 02.11.2022/16:15 Receptionat/inregistrat de: Hategan E. Data si ora efectuarii analizei: 02.11.2022/16:30 Data si ora finalizarii analizei: 02.11.2022/21:30 Data si ora eliberarii rezultatului: 03.11.2022/10:00
---	---

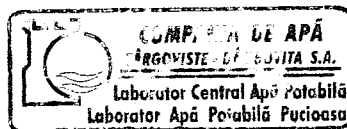
Metode de prelevare:ISO 5667-5/2017; SR EN ISO 5667-1/2022; SR EN ISO 5667-3/2018; SR EN ISO 5667-14/2017

Parametrii analizati	UM	Valoare CMA	Valoarea determinata	Metode de analiza
Concentratia ionilor de H	Unitati pH	$\geq 6,5 - \leq 9,5$	7,7(20°C)	SR EN ISO 10523:2012
Conductivitate	$\mu S / cm$ la 20°C	2500	373	SR EN 27888:1997
Turbiditate	NTU	≤ 5	0,60	SR EN ISO 7027-1:2016
Clor rezidual liber	mg/l	$\geq 0,1$ statie,rezervor $\geq 0,1 - \leq 0,5$ retea	0,37	SR EN ISO 7393-1:2002
Clor rezidual total	mg/l		0,41	SR EN ISO 7393-1:2002
% clor rezidual liber din clorul rezidual total	%	Min.80	90	
Amoniu (NH_4^+)	mg/l	0,5	SLQ	SR ISO 7150-1:2001
Culoare	-	1)	1	SR EN ISO 7887:2012-metoda C
Miros	-	2)	2	SR EN 1622:2007
Gust	-	3)	3	SR EN 1622:2007
Aluminiu	$\mu g/l$	200	109,06	SR ISO 10566:2001
Nitrati(NO_3^-)	mg/l	50	-	SR ISO 7890-3:2000
Nitriti (NO_2^-)	mg/l	0,1 statie,rezervor 0,5 retea	-	SR EN 26777:2002 SR EN 26777:2002/C91:2006
Mangan	$\mu g/l$	50	-	SR ISO 6333:1997
Fier (Fe^{2+}, Fe^{3+})	$\mu g/l$	200	-	SR ISO 6332:1996/C91:2006
Suma de calciu si magneziu	Grade Germane	Minim 5	-	SR ISO 6059:2008
Indice de permanganat	mgO_2/l	5	-	SR EN ISO 8467:2001
Cloruri (Cl^-)	mg/l	250	-	SR ISO 9297:2001
Sulfati	mg/l	250	-	STAS 3069:1987

1)Acceptabila consumatorilor si nicio modificare anormala; 2)Acceptabil consumatorilor si niciun miros anormal; 3) Acceptabil consumatorilor si niciun gust anormal

*Notatia SLQ="sub limita de cuantificare a metodei"

*LQ: amoniu <0,019 mg/l

SEF LABORATOR
Ch. Dimian ClaudiaRESPONSABIL ANALIZA
Ch. Dimian Claudia

Cod F-17-6/2

Reproducerea buletinului de analiza fara acceptul scris al laboratorului este interzisa!
Rezultatele analizelor se refera numai la proba prelevata si analizata.

COMPANIA DE APA TARGOVISTE DAMBOVITA S.A.**DEPARTAMENT MANAGEMENT INTEGRAT CALITATE****LABORATOR CENTRAL APA POTABILA**

Legea 458/2002(republicata) privind calitatea apei potabile-modificata si completata cu Ordonanta 22/2017

LABORATOR APA POTABILA PUCIOASA

Laborator inregistrat la Ministerul Sanatatii - Certificat nr. 592/24.10.2022, str.Debarcaderului nr.1-Pucioasa,Tel/Fax 0245762640

BULETIN DE ANALIZA MICROBIOLOGICA NR.1791

Solicitant: Sectia Moreni Loc de prelevare: Moreni, str. Mihai Eminescu- Depozit Constructii Elix Dan Punct de prelevare: robinet cismea curte Cod proba: 69 Scopul analizei: verificarea calitatii apei-avarie retea Produs analizat: apa potabila Prelevat de: Virlan G.	Fisa prelevare nr: 2474 Data si ora prelevarii probei: 02.11.2022/15:00 Data si ora receptiei probei: 02.11.2022/16:15 Receptionat/inregistrat de: Hategan E. Data si ora efectuării analizei: 02.11.2022/16:30 Data si ora finalizarii analizei: 05.11.2022/10:00 Data si ora eliberării rezultatului: 07.11.2022/09:00 Correspondent cu buletin analiza fizico-chimica nr. 1834
---	--

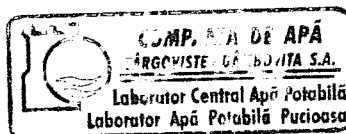
Metode de prelevare :ISO 5667-5/2017;SR EN ISO 5667-1/2022;SR EN ISO 5667-3/2018;SR EN ISO 19458/2007;SR EN ISO 5667-14/2017

PARAMETRII MICROBIOLOGICI DE CALITATE AI APEI POTABILE

Parametrii analizati	UM	Valoare CMA	Valoare determinata	Metode de analiza
Escherichia coli	UFC/100 ml	0	0	SR EN ISO 9308-1:2015 SR EN ISO 9308-1:2015/A1:2017
Enterococi intestinali	UFC/100 ml	0	0	SR EN ISO 7899-2/2002

PARAMETRII INDICATORI

Parametrii analizati	UM	Valoare CMA	Valoare determinata	Metode de analiza
Bacterii coliforme	UFC/100 ml	0	0	SR EN ISO 9308-1:2015 SR EN ISO 9308-1:2015/A1:2017
Nr. de colonii la 22°C	UFC/ 1ml	Nicio modificare anormala	10	SR EN ISO 6222/2004
Nr. de colonii la 37°C	UFC/ 1ml	Nicio modificare anormala	0	SR EN ISO 6222/2004
Clostridium perfringens	UFC/100 ml	0	0	SR EN ISO 14189/2017

SEF LABORATOR
Ch. Dimian ClaudiaRESPONSABIL ANALIZA
Biolog Manoiu Mirabela

Cod F-17-7/2

Reproducerea buletinului de analiza fara acceptul scris al laboratorului este interzisa!
Rezultatele analizelor se refera numai la proba prelevata si analizata.

Pag.1/1

Exemplar nr.

3

COMPANIA DE APA TARGOVISTE DAMBOVITA S.A.**DEPARTAMENT MANAGEMENT INTEGRAT CALITATE****LABORATOR CENTRAL APA POTABILA**

Legea 458/2002(republicata) privind calitatea apei potabile-modificata si completata cu Ordonanta 22/2017

LABORATOR APA POTABILA PUCIOASA

Laborator inregistrat la Ministerul Sanatatii - Certificat nr. 592/24.10.2022, str.Debarcaderului nr.1-Pucioasa,Tel/Fax 0245762640

BULETIN DE ANALIZA FIZICO – CHIMICA NR. 1840

Solicitant: Sectia Moreni Loc de prelevare: Moreni, str. Mihai Eminescu- Magazin Bryana Corandry Punct de prelevare: robinet chiuveta magazin Cod proba: 68 Scopul analizei: verificarea calitatii apei-avarie retea Produs analizat: apa potabila Prelevat de: Virlian G.	Fisa prelevare nr: 2482 Data si ora prelevarii probei: 03.11.2022/13:00 Data si ora receptiei probei: 03.11.2022/14:30 Receptionat/inregistrat de: Bratulescu N. Data si ora efectuării analizei: 03.11.2022/15:00 Data si ora finalizării analizei: 03.11.2022/18:40 Data si ora eliberării rezultatului: 04.11.2022/11:00
---	--

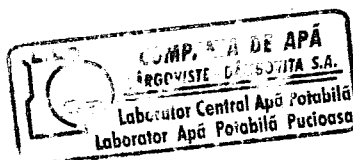
Metode de prelevare:ISO 5667-5/2017; SR EN ISO 5667-1/2022; SR EN ISO 5667-3/2018; SR EN ISO 5667-14/2017

Parametrii analizati	UM	Valoare CMA	Valoarea determinata	Metode de analiza
Concentratia ionilor de H	Unitati pH	$\geq 6,5 - \leq 9,5$	7,6(20°C)	SR EN ISO 10523:2012
Conductivitate	$\mu S / cm$ la 20°C	2500	368	SR EN 27888:1997
Turbiditate	NTU	≤ 5	1,61	SR EN ISO 7027-1:2016
Clor rezidual liber	mg/l	$\geq 0,1$ statie,rezervor $\geq 0,1 - \leq 0,5$ retea	0,40	SR EN ISO 7393-1:2002
Clor rezidual total	mg/l		0,45	SR EN ISO 7393-1:2002
% clor rezidual liber din clorul rezidual total	%	Min.80	89	
Amoniu (NH ₄ ⁺)	mg/l	0,5	SLQ	SR ISO 7150-1:2001
Culoare	-	1)	1	SR EN ISO 7887:2012-metoda C
Miros	-	2)	2	SR EN 1622:2007
Gust	-	3)	3	SR EN 1622:2007
Aluminiu	$\mu g/l$	200	61,62	SR ISO 10566:2001
Nitrati(NO ₃ ⁻)	mg/l	50	-	SR ISO 7890-3:2000
Nitriti (NO ₂ ⁻)	mg/l	0,1 statie,rezervor 0,5 retea	-	SR EN 26777:2002 SR EN 26777:2002/C91:2006
Mangan	$\mu g/l$	50	-	SR ISO 6333:1997
Fier (Fe ²⁺ ,Fe ³⁺)	$\mu g/l$	200	-	SR ISO 6332:1996/C91:2006
Suma de calciu si magneziu	Grade Germane	Minim 5	-	SR ISO 6059:2008
Indice de permanganat	mgO ₂ /l	5	-	SR EN ISO 8467:2001
Cloruri (Cl ⁻)	mg/l	250	-	SR ISO 9297:2001
Sulfati	mg/l	250	-	STAS 3069:1987

1)Acceptabila consumatorilor si nicio modificare anormala; 2)Acceptabil consumatorilor si niciun miros anormal; 3) Acceptabil consumatorilor si niciun gust anormal

*Notatia SLQ="sub limita de cuantificare a metodei"

*LQ: amoniu <0,019 mg/l

SEF LABORATOR
Ch. Dimian ClaudiaRESPONSABIL ANALIZA
Ch. Dimian Claudia

Cod F-17-6/2

Reproducerea buletinului de analiza fara acceptul scris al laboratorului este interzisa!
Rezultatele analizelor se refera numai la proba prelevata si analizata.

COMPANIA DE APA TARGOVISTE DAMBOVITA S.A.**DEPARTAMENT MANAGEMENT INTEGRAT CALITATE****LABORATOR CENTRAL APA POTABILA**

Legea 458/2002(republicata) privind calitatea apei potabile-modificata si completata cu Ordonanta 22/2017

LABORATOR APA POTABILA PUCIOASA

Laborator inregistrat la Ministerul Sanatatii - Certificat nr. 592/24.10.2022, str.Debarcaderului nr.1-Pucioasa,Tel/Fax 0245762640

BULETIN DE ANALIZA MICROBIOLOGICA NR.1797

Solicitant: Sectia Moreni	Fisa prelevare nr: 2482
Loc de prelevare: Moreni, str. Mihai Eminescu- Magazin Bryana Corandry	Data si ora prelevarii probei: 03.11.2022/13:00
Punct de prelevare: robinet chiuveta magazin	Data si ora receptiei probei: 03.11.2022/14:30
Cod proba: 68	Receptionat/inregistrat de: Bratulescu N.
Scopul analizei: verificarea calitatii apei-avarie retea	Data si ora efectuarii analizei: 03.11.2022/15:00
Produs analizat: apa potabila	Data si ora finalizarii analizei: 06.11.2022/09:00
Prelevat de: Virlan G.	Data si ora eliberarii rezultatului: 07.11.2022/09:00
	Correspondent cu buletin analiza fizico-chimica nr. 1840

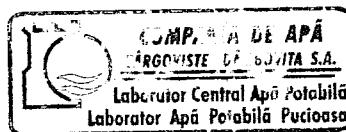
Metode de prelevare :ISO 5667-5/2017;SR EN ISO 5667-1/2022;SR EN ISO 5667-3/2018;SR EN ISO 19458/2007;SR EN ISO 5667-14/2017

PARAMETRII MICROBIOLOGICI DE CALITATE AI APEI POTABILE

Parametrii analizati	UM	Valoare CMA	Valoare determinata	Metode de analiza
Escherichia coli	UFC/100 ml	0	0	SR EN ISO 9308-1:2015 SR EN ISO 9308-1:2015/A1:2017
Enterococi intestinali	UFC/100 ml	0	0	SR EN ISO 7899-2/2002

PARAMETRII INDICATORI

Parametrii analizati	UM	Valoare CMA	Valoare determinata	Metode de analiza
Bacterii coliforme	UFC/100 ml	0	0	SR EN ISO 9308-1:2015 SR EN ISO 9308-1:2015/A1:2017
Nr. de colonii la 22°C	UFC/ 1ml	Nicio modificare anormala	1	SR EN ISO 6222/2004
Nr. de colonii la 37°C	UFC/ 1ml	Nicio modificare anormala	1	SR EN ISO 6222/2004
Clostridium perfringens	UFC/100 ml	0	0	SR EN ISO 14189/2017

SEF LABORATOR
Ch. Dimian ClaudiaRESPONSABIL ANALIZA
Biolog Manoiu Mirabela

Cod F-17-7/2

Reproducerea buletinului de analiza fara acceptul scris al laboratorului este interzisa!
Rezultatele analizelor se refera numai la proba prelevata si analizata.

Pag.1/1

Exemplar nr. 3

COMPANIA DE APA TARGOVISTE DAMBOVITA S.A.**DEPARTAMENT MANAGEMENT INTEGRAT CALITATE****LABORATOR CENTRAL APA POTABILA**

Legea 458/2002(republicata) privind calitatea apei potabile-modificata si completata cu Ordonanta 22/2017

LABORATOR APA POTABILA PUCIOASA

Laborator inregistrat la Ministerul Sanatatii - Certificat nr. 592/24.10.2022, str.Debarcaderului nr.1-Pucioasa,Tel/Fax 0245762640

BULETIN DE ANALIZA FIZICO – CHIMICA NR. 1841

Solicitant: Sectia Moreni Loc de prelevare: Moreni, str. Mihai Eminescu- Depozit Constructii Elix Dan Punct de prelevare: robinet cisterna curte Cod proba: 69 Scopul analizei: verificarea calitatii apei-avarie retea Produs analizat: apa potabila Prelevat de: Virlan G.	Fisa prelevare nr: 2483 Data si ora prelevarii probei: 03.11.2022/13:30 Data si ora receptiei probei: 03.11.2022/14:30 Receptionat/inregistrat de: Bratulescu N. Data si ora efectuării analizei: 03.11.2022/15:00 Data si ora finalizării analizei: 03.11.2022/18:40 Data si ora eliberării rezultatului: 04.11.2022/11:00
---	--

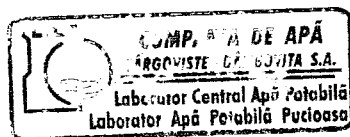
Metode de prelevare:ISO 5667-5/2017; SR EN ISO 5667-1/2022; SR EN ISO 5667-3/2018; SR EN ISO 5667-14/2017

Parametrii analizati	UM	Valoare CMA	Valoarea determinata	Metode de analiza
Concentratia ionilor de H	Unitati pH	$\geq 6,5 - \leq 9,5$	7,6(20°C)	SR EN ISO 10523:2012
Conductivitate	$\mu S / cm$ la 20°C	2500	370	SR EN 27888:1997
Turbiditate	NTU	≤ 5	1,43	SR EN ISO 7027-1:2016
Clor rezidual liber	mg/l	$\geq 0,1$ statie,rezervor $\geq 0,1 - \leq 0,5$ retea	0,40	SR EN ISO 7393-1:2002
Clor rezidual total	mg/l		0,45	SR EN ISO 7393-1:2002
% clor rezidual liber din clorul rezidual total	%	Min.80	89	
Amoniu (NH ₄ ⁺)	mg/l	0,5	SLQ	SR ISO 7150-1:2001
Culoare	-	1)	1	SR EN ISO 7887:2012-metoda C
Miros	-	2)	2	SR EN 1622:2007
Gust	-	3)	3	SR EN 1622:2007
Aluminiu	$\mu g/l$	200	60,53	SR ISO 10566:2001
Nitrati(NO ₃ ⁻)	mg/l	50	-	SR ISO 7890-3:2000
Nitriti (NO ₂ ⁻)	mg/l	0,1 statie,rezervor 0,5 retea	-	SR EN 26777:2002 SR EN 26777:2002/C91:2006
Mangan	$\mu g/l$	50	-	SR ISO 6333:1997
Fier (Fe ²⁺ ,Fe ³⁺)	$\mu g/l$	200	-	SR ISO 6332:1996/C91:2006
Suma de calciu si magneziu	Grade Germane	Minim 5	-	SR ISO 6059:2008
Indice de permanganat	mgO ₂ /l	5	-	SR EN ISO 8467:2001
Cloruri (Cl ⁻)	mg/l	250	-	SR ISO 9297:2001
Sulfati	mg/l	250	-	STAS 3069:1987

1)Acceptabila consumatorilor si nicio modificare anormala; 2)Acceptabil consumatorilor si niciun miros anormal; 3) Acceptabil consumatorilor si niciun gust anormal

*Notatia SLQ="sub limita de cuantificare a metodei"

*LQ: amoniu <0,019 mg/l

SEF LABORATOR
Ch. Dimian ClaudiaRESPONSABIL ANALIZA
Ch. Dimian Claudia

Cod F-17-6/2

Reproducerea buletinului de analiza fara acceptul scris al laboratorului este interzisa!
Rezultatele analizelor se refera numai la proba prelevata si analizata.

COMPANIA DE APA TARGOVISTE DAMBOVITA S.A.

DEPARTAMENT MANAGEMENT INTEGRAT CALITATE

LABORATOR CENTRAL APA POTABILA

Legea 458/2002(republicata) privind calitatea apei potabile-modificata si completata cu Ordonanta 22/2017

LABORATOR APA POTABILA PUCIOASA

Laborator inregistrat la Ministerul Sanatatii - Certificat nr. 592/24.10.2022, str.Debarcaderului nr.1-Pucioasa,Tel/Fax 0245762640

BULETIN DE ANALIZA MICROBIOLOGICA NR.1798

Solicitant: Sectia Moreni

Loc de prelevare: Moreni, str. Mihai Eminescu- Depozit Constructii Elix Dan

Punct de prelevare: robinet cisterna curte

Cod proba: 69

Scopul analizei: verificarea calitatii apei-avarie retea

Produs analizat: apa potabila

Prelevat de: Virgil G.

Fisa prelevare nr: 2483

Data si ora prelevarii probei: 03.11.2022/13:30

Data si ora receptiei probei: 03.11.2022/14:30

Receptionat/inregistrat de: Bratulescu N.

Data si ora efectuării analizei: 03.11.2022/15:00

Data si ora finalizării analizei: 06.11.2022/09:00

Data si ora eliberării rezultatului: 07.11.2022/09:00

Correspondent cu buletin analiza fizico-chimica nr. 1841

Metode de prelevare :ISO 5667-5/2017;SR EN ISO 5667-1/2022;SR EN ISO 5667-3/2018;SR EN ISO 19458/2007;SR EN ISO 5667-14/2017

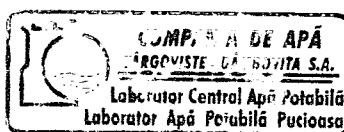
PARAMETRII MICROBIOLOGICI DE CALITATE AI APEI POTABILE

Parametrii analizati	UM	Valoare CMA	Valoare determinata	Metode de analiza
Escherichia coli	UFC/100 ml	0	0	SR EN ISO 9308-1:2015 SR EN ISO 9308-1:2015/A1:2017
Enterococi intestinali	UFC/100 ml	0	0	SR EN ISO 7899-2/2002

PARAMETRII INDICATORI

Parametrii analizati	UM	Valoare CMA	Valoare determinata	Metode de analiza
Bacterii coliforme	UFC/100 ml	0	0	SR EN ISO 9308-1:2015 SR EN ISO 9308-1:2015/A1:2017
Nr. de colonii la 22°C	UFC/ 1ml	Nicio modificare anormala	0	SR EN ISO 6222/2004
Nr. de colonii la 37°C	UFC/ 1ml	Nicio modificare anormala	1	SR EN ISO 6222/2004
Clostridium perfringens	UFC/100 ml	0	0	SR EN ISO 14189/2017

SEF LABORATOR
Ch. Dimian Claudia



RESPONSABIL ANALIZA
Biolog Manoiu Mirabela

Cod F-17-7/2

Reproducerea buletinului de analiza fara acceptul scris al laboratorului este interzisa!
Rezultatele analizelor se refera numai la proba prelevata si analizata.

Pag.1/1

Exemplar nr.

3